


# RECOMMENDED SPARK DETECTION SYSTEM DESIGN ON SYSTEMS RECYCLING EXHAUST AIR

SEE NFPA 664 8.2.2.7 (2017 EDITION)

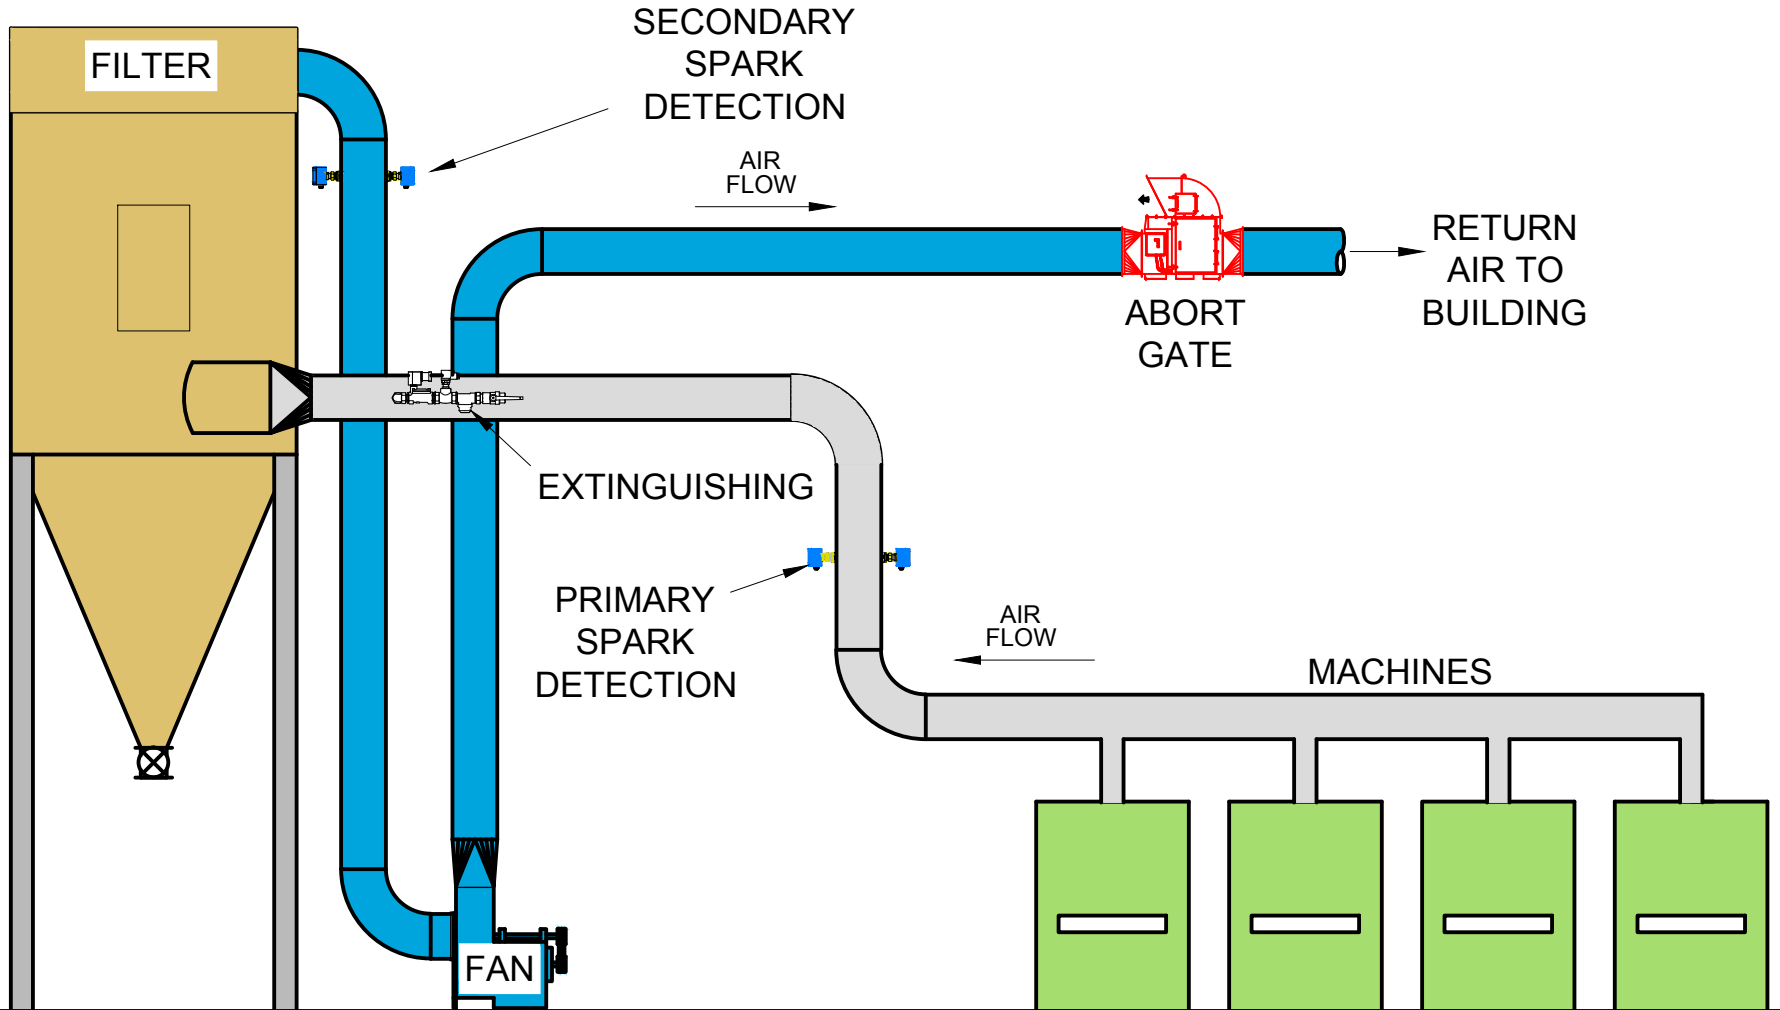

 **FLAMEX<sup>®</sup> INC.**

4365 Federal Dr.  
Greensboro, NC 27407  
PH (336) 299-2933 FAX (336) 299-2944